


NOTE:  
FOR TRACER WIRE INSTALLATION  
REQUIREMENTS, REFER TO THE  
MINNESOTA RURAL WATER  
ASSOCIATION STANDARD DETAILS.

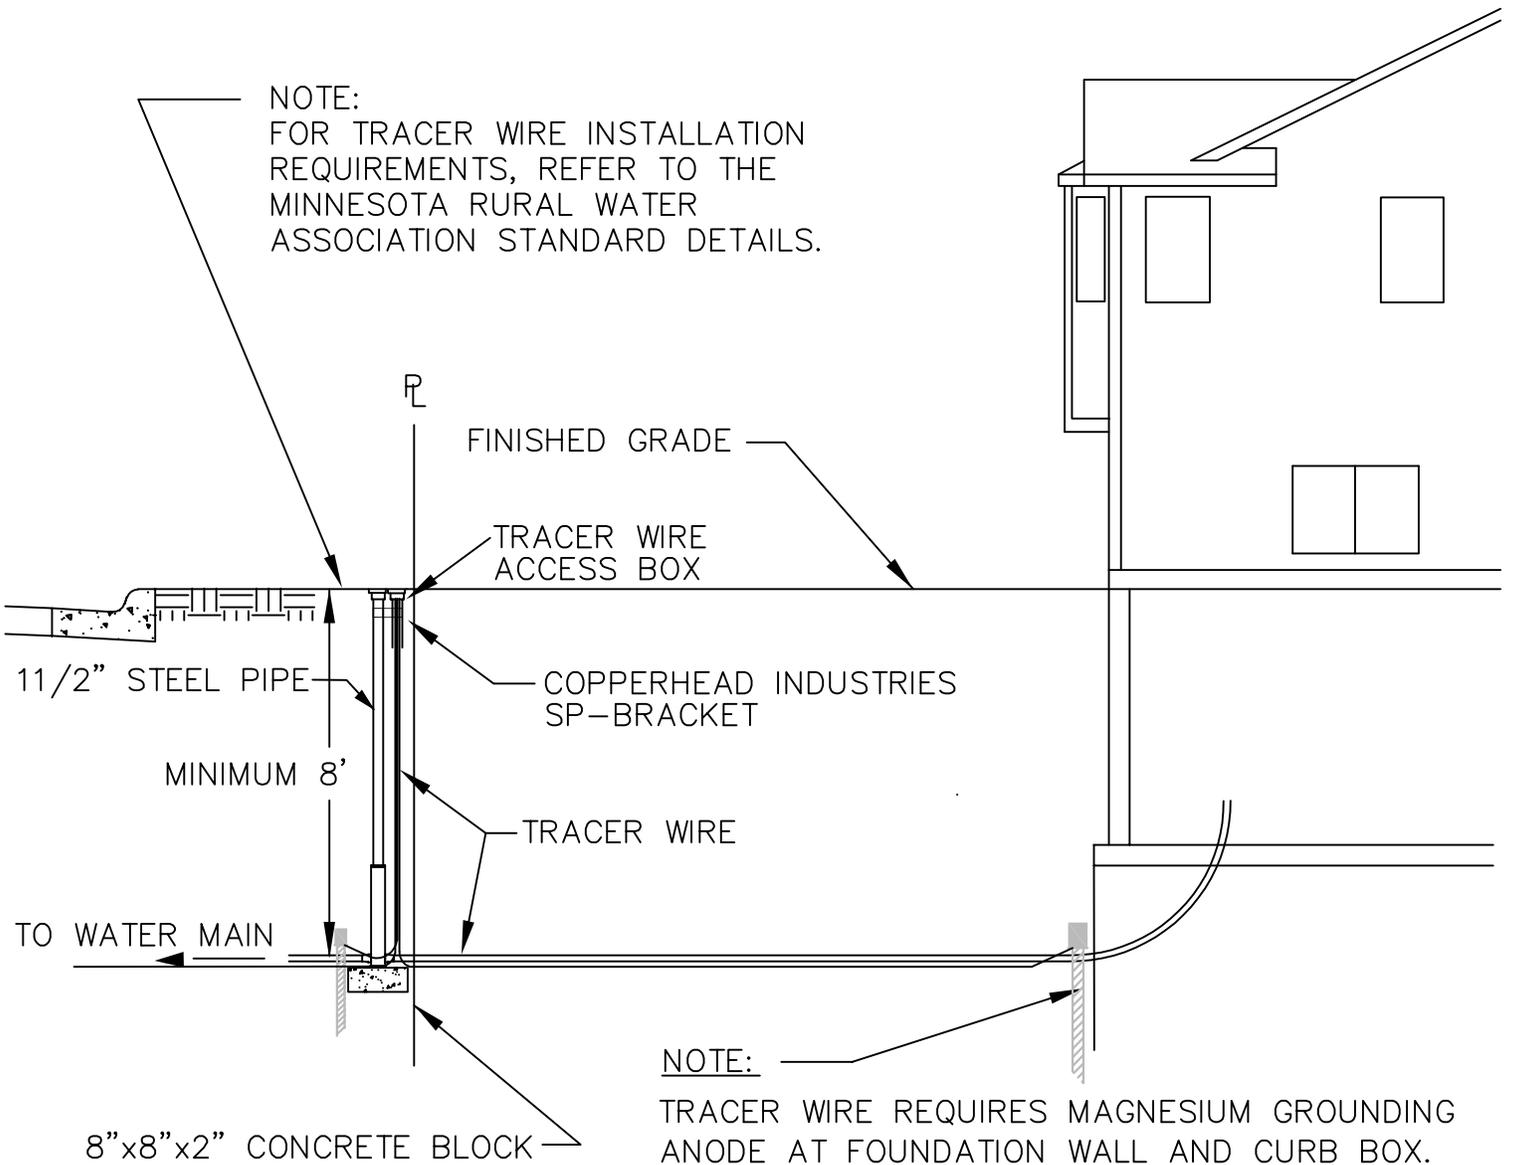

NOTE:  
TRACER WIRE REQUIRES MAGNESIUM GROUNDING  
ANODE AT FOUNDATION WALL AND CURB BOX.

APPROVED MATERIALS FOR COPPER & (PLASTIC) PIPING:

CURB STOP – 1" CURB STOP AY MCDONALD 76104 OR (PLASTIC 76104-33)

CURB BOX – CURB BOX AY MCDONALD SERIES 5622A 8 CURB BOX COMPLETE  
W/ 5623LTW LID

PIPE MATERIAL – ACCORDING TO STATE PLUMBING CODE: COPPER AND PLASTIC  
(PLASTIC PIPE REQUIRES 1" STAINLESS STEEL INSERT AY MCDONALD 6136)

TRACER BOX ACCESS BOX – SHALL INCLUDE SNAKEPIT BRACKET BY COPPERHEAD

APPROVED JANUARY 16, 2020

CITY ENGINEER REG 23110

**TYPICAL WATER SERVICE  
(PROPERTY LINE TO  
HOUSE)**

City of  
**Golden Valley**  
GV-WM-030