


SET 1/4" BELOW FINISHED  
BITUMINOUS ELEVATION


FINISHED  
GRADE



FITTINGS – ALL FITTINGS SHALL BE EPOXY  
COATED DUCTILE IRON AND BOLTED WITH  
EPOXY COATED STAINLESS STEEL OR  
COR-BLUE BOLTS AND NUTS.

GATE VALVE – AVK VALVE SERIES 65 WITH  
EXTERIOR EPOXY COATING.

GATE VALVE BOX – SIZE G DUCTILE IRON,  
TYLER 6860, WITH 5" DROP LID HAVING THE  
WORD "WATER" CAST THEREON AND #6  
ROUND BASE. THE BOXES SHALL EXTEND  
NOT LESS THAN 12" UPWARD FROM INITIAL  
INSTALLED POSITION AND INCLUDE A POWER  
SEAL MODEL 5000 VALVE BOX ALIGNER,  
EPOXY COATED 1/4" STEEL PER ASTM  
A53/A512.

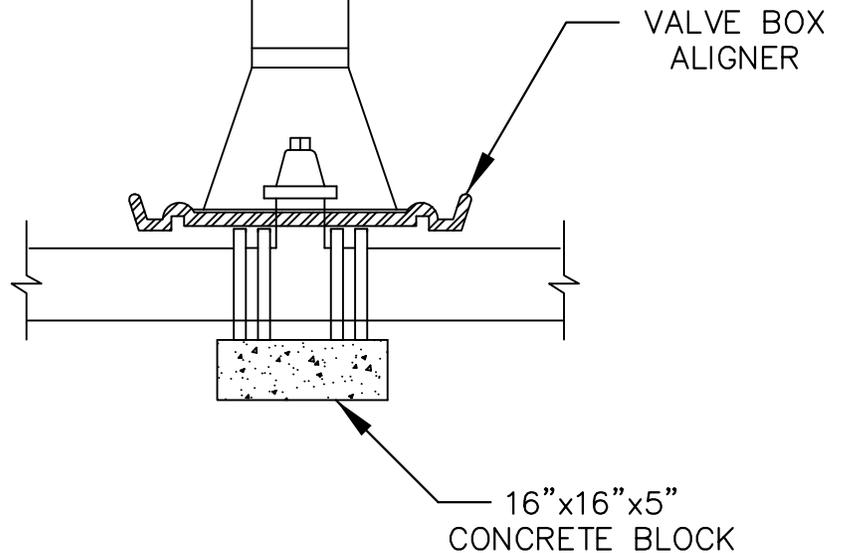

APPROVED JANUARY 1, 2018

CITY ENGINEER REG 23110

**TYPICAL GATE VALVE  
INSTALLATION**

City  
of **Golden Valley**

**GV-WM-060**