


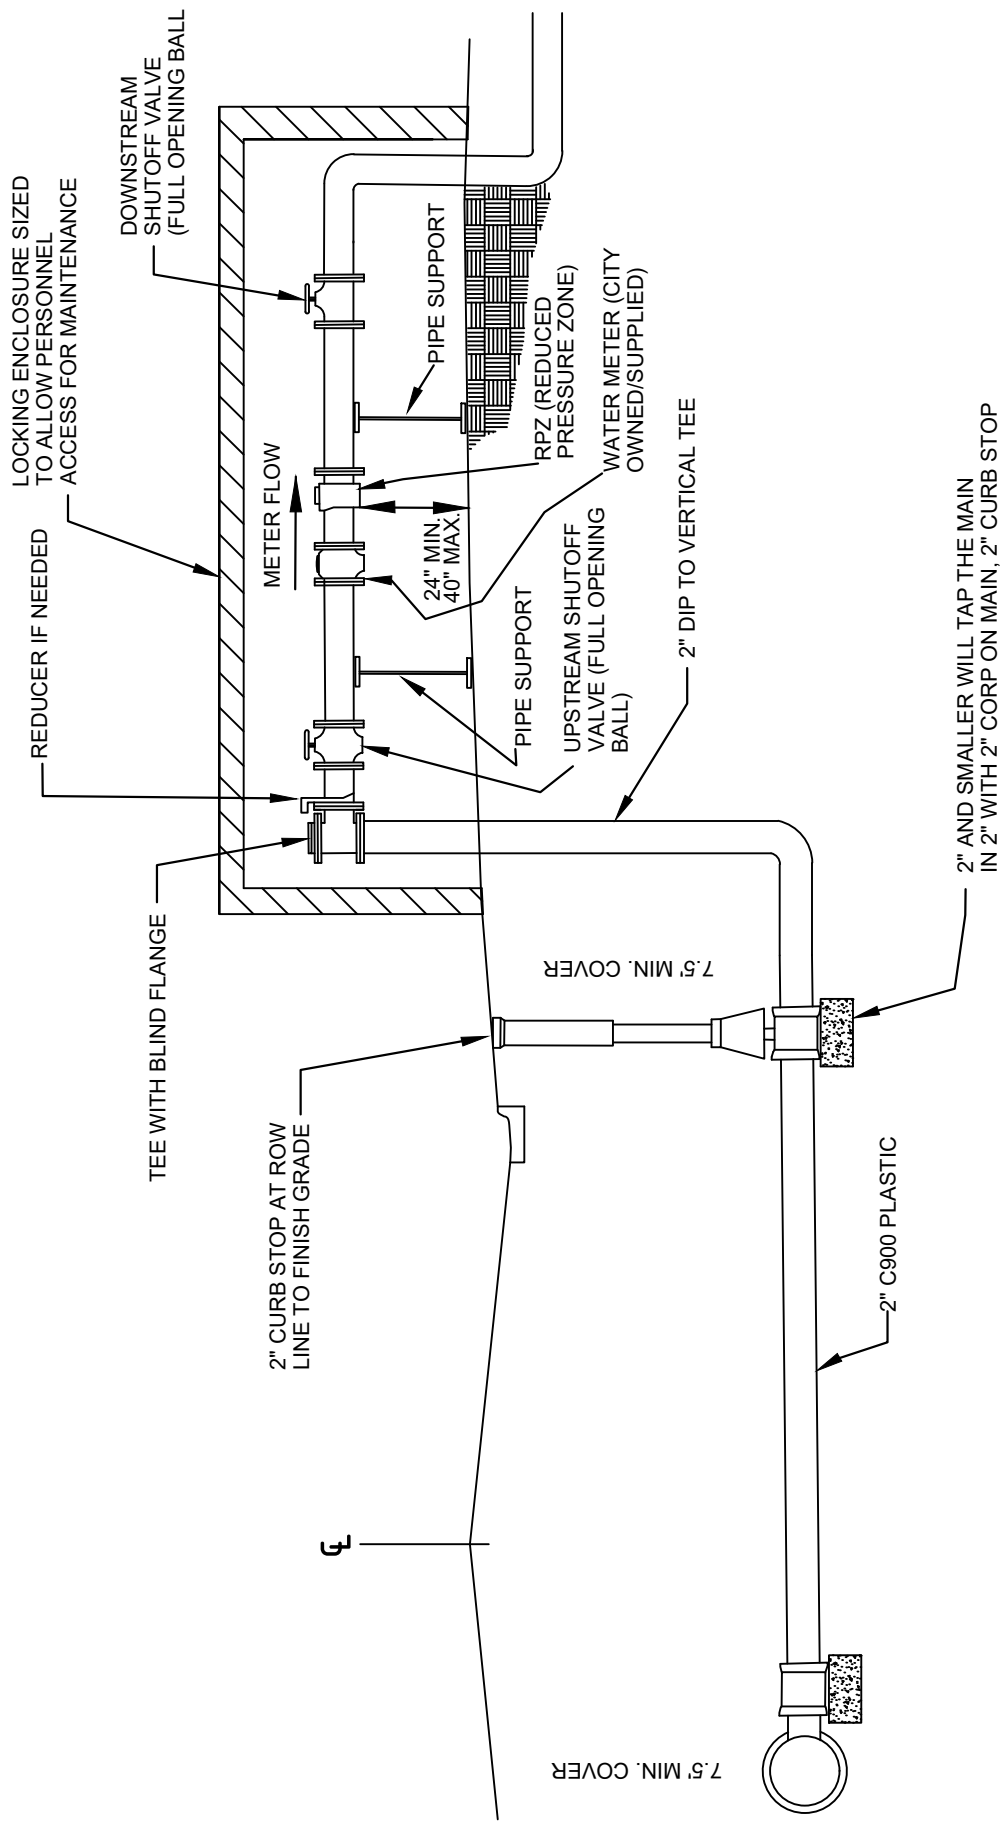

1. THE METER AND RPZ MUST BE PULLED FOR THE WINTER MONTHS. SCHEDULE REMOVAL WITH CITY UTILITY DEPT.
2. REDUCED PRESSURE ZONE (RPZ'S) MUST BE PULLED WHEN THE WATER SERVICE IS TURNED OFF.
3. A COPY OF THE BACKFLOW PREVENTION TEST MUST BE FORWARDED TO THE CITY WITHIN ONE WEEK OF SYSTEM STARTUP.
4. PIPE SIZE MAY BE REDUCED PAST VERTICAL TEE. REDUCED PIPE MATERIAL PAST TEE SHALL BE COPPER, STAINLESS STEEL OR BRASS WITHIN ENCLOSURE FOR WINTERIZING PURPOSES. NO PVC OR GALVANIZED ALLOWED.

APPROVED JANUARY 1, 2024

CITY ENGINEER REG 23110

City

GV-WM-130